


KEYED NOTES:

- 1 PROVIDE ADEQUATE CLEARANCE ABOVE UNIT FOR OPERATION OF VALVES OR UNIT REPAIR.
- 2 AIR GAP FITTING FURNISHED WITH BACKFLOW PREVENTER.
- 3 BYPASS PIPING AROUND BFP IS PROHIBITED.

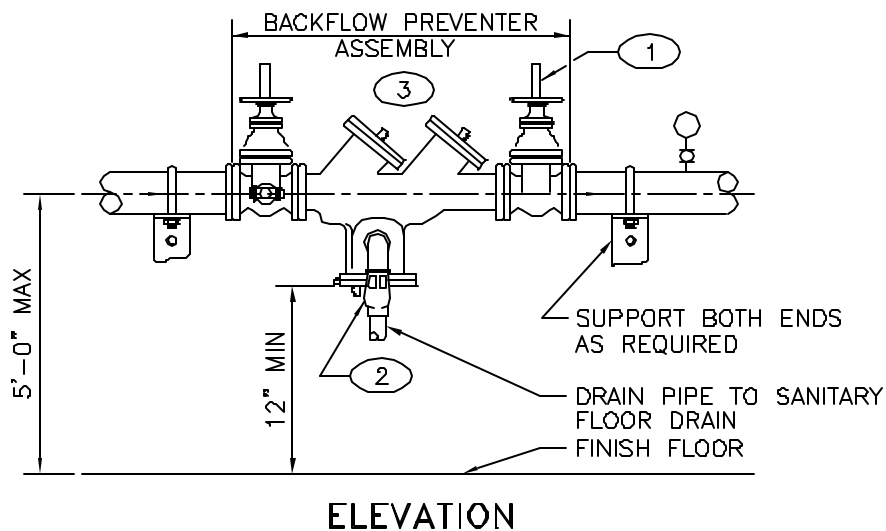

DRAWING DEVELOPED FOR ML-3/
ML-4 PROJECTS. FOR ML-1/
ML-2, ADDITIONAL REQUIREMENTS
AND QA REVIEWS ARE REQUIRED.
(REMOVE THIS NOTE WHEN IN-
SERTED INTO A DRAWING PACK-
AGE).

BACKFLOW PREVENTER DETAIL

SCALE: NONE

NOTES FOR DESIGNER: (DO NOT INCLUDE ON CONSTRUCTION DRAWINGS)

1. SEE SHEET 3

[illegible]